


1U 24 Port Angled Patch Panel

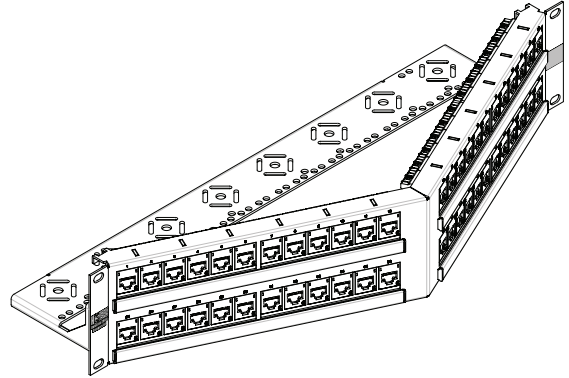

2U 48 Port Angled Patch Panel

1. Parts List

- 1) Angled Patch Panel
- 2) Cable management shelf
- 3) Front label extrusion with label
- 4) Global hardware kit

Note: Only one cable management shelf included with each 1U 24 port and 2U 48 port patch panel.

Step 1

With the hardware kit provided, mount panel to rack so that the jack ports are facing forward and the IDC connectors are in the rear.

Step 2

Route cable along intended pathway through the frame or enclosure to the desired location on the rear-side of the panel. Allow a 6" slack or service loop at the rear of the panel. A 1.5" minimum bend radius for each port is recommended during termination and dressing of individual ports.

Step 3

Prepare individual 4-pair cables by stripping back insulation 1.5" exposing individual wires.

Step 4



Beginning with jack one, located on the far-right top row, terminate ports by laying the wires in the proper sequence across the contacts and by punching down with a punch down tool (see Fig. 1 & Fig. 2).

Step 5

Assemble rear cable management shelf to the patch panel and tie down terminated cables with cable ties or velcro straps (see Fig. 3).
Note: Cable ties or velcro straps are not included with panel.

Step 6

Utilize the labeling directions supplied on the label sheets in order to print the labels. Slide in two label inserts per label extrusion. Mount a loaded label extrusion onto the front of the patch panel by inserting into extrusion mounts (see Fig. 4).

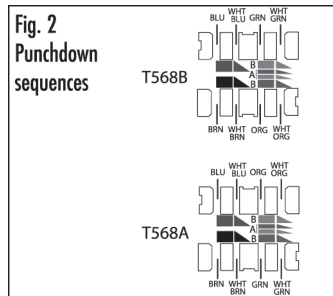

Follow color code on label as marked with "B"

Follow color code on label as marked with "A"

