


VARIOKEYSTONE® 1U 24P UNLD PP TERMINATION

1.0 SCOPE

This document provides instructions on how to terminate jacks and cable in a VarioKeystone® Patch Panel:

LPP-00009- VARIOKEYSTONE PATCH PANEL 1U 24 PORT UNLOADED

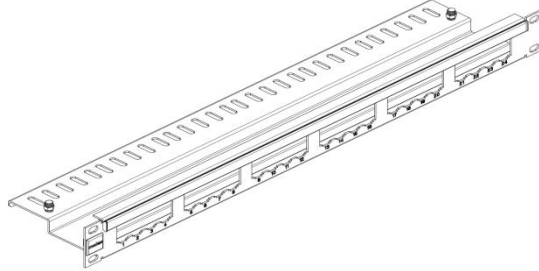

2.0 PRODUCT DESCRIPTION

VARIOKEYSTONE PATCH PANEL 1U 24 PORT UNLOADED, Patch Panel can accommodate 24 single or 12 double jacks. It can be installed in a 19" rack or cabinet.

3.0 PROCEDURE


Tools required for proper termination:

- Philips Screw driver to fix the earth link
- Flat screw driver to install patch panel in a 19" Rack

VarioKeystone® Patch Panel termination


- 1) Install jacks in a Patch Panel. Secure each cable with a cable tie (Fig 1 and Fig 2).

Fig.1

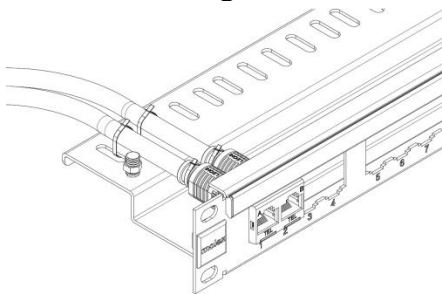

- 2) Connect earth link to a Patch Panel (Fig.2).

Fig.2

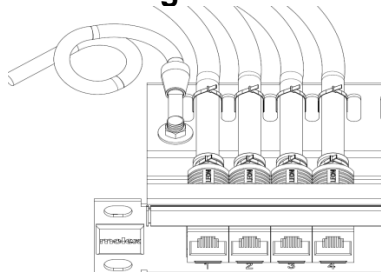

- 3) Install the panel in a 19" Rack or Cabinet. Dress Cable bundles neatly on both sides of 19" Rack (Fig 3).

Fig.3

